
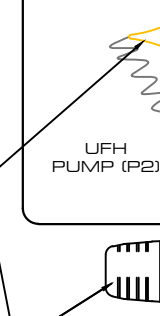

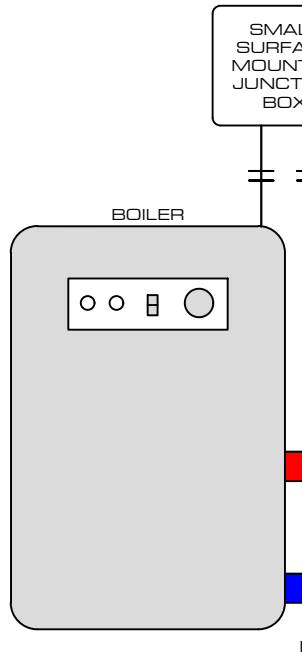
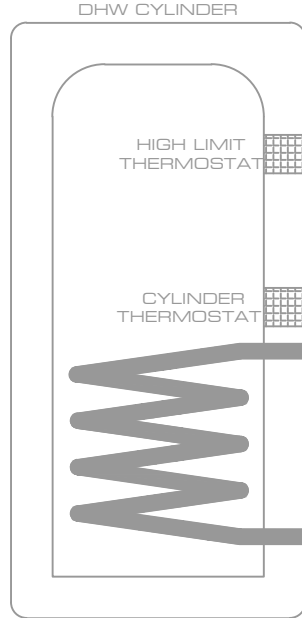
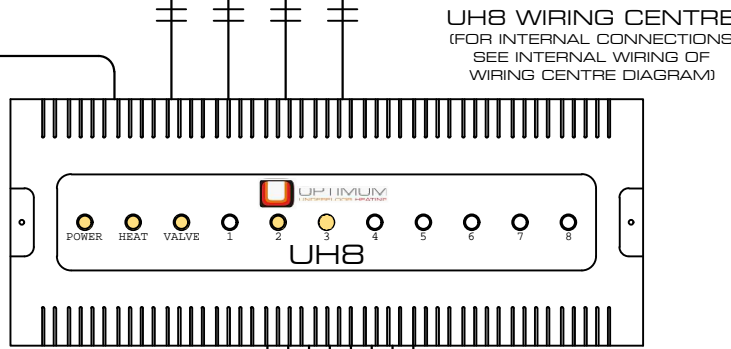
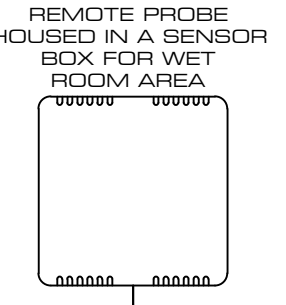







neoSTAT CONTROL
 PLANT & WIRING LAYOUT -
 HIGH TEMP. SYSTEM (V1-UFH)
 neoSTAT

- IMPORTANT NOTES:**
1. ALL CABLES ARE SHOWN WITH THE NECESSARY LIVE, NEUTRAL & SWITCHED LIVE CORES, WITH THE EARTH CORE OMITTED. ALL THESE CABLES ARE TO BE MAINS RATED 1.5mm² CABLES.
 2. ALL PIPE SIZING MUST BE CALCULATED IN ACCORDANCE WITH THE REQUIRED FLOW RATES AND LOADING OF THE SYSTEM.
 3. ALL WORK CARRIED OUT MUST BY QUALIFIED ENGINEERS AND IN ACCORDANCE WITH CURRENT REGULATIONS.
 4. ALL CONNECTIONS AT THE BOILER MUST BE MADE IN ACCORDANCE WITH THE MANUFACTURERS INSTRUCTIONS.

IF YOU HAVE ANY QUERIES REGARDING THE INSTALLATION, PLEASE DO NOT HESITATE TO CONTACT OUR OFFICE.

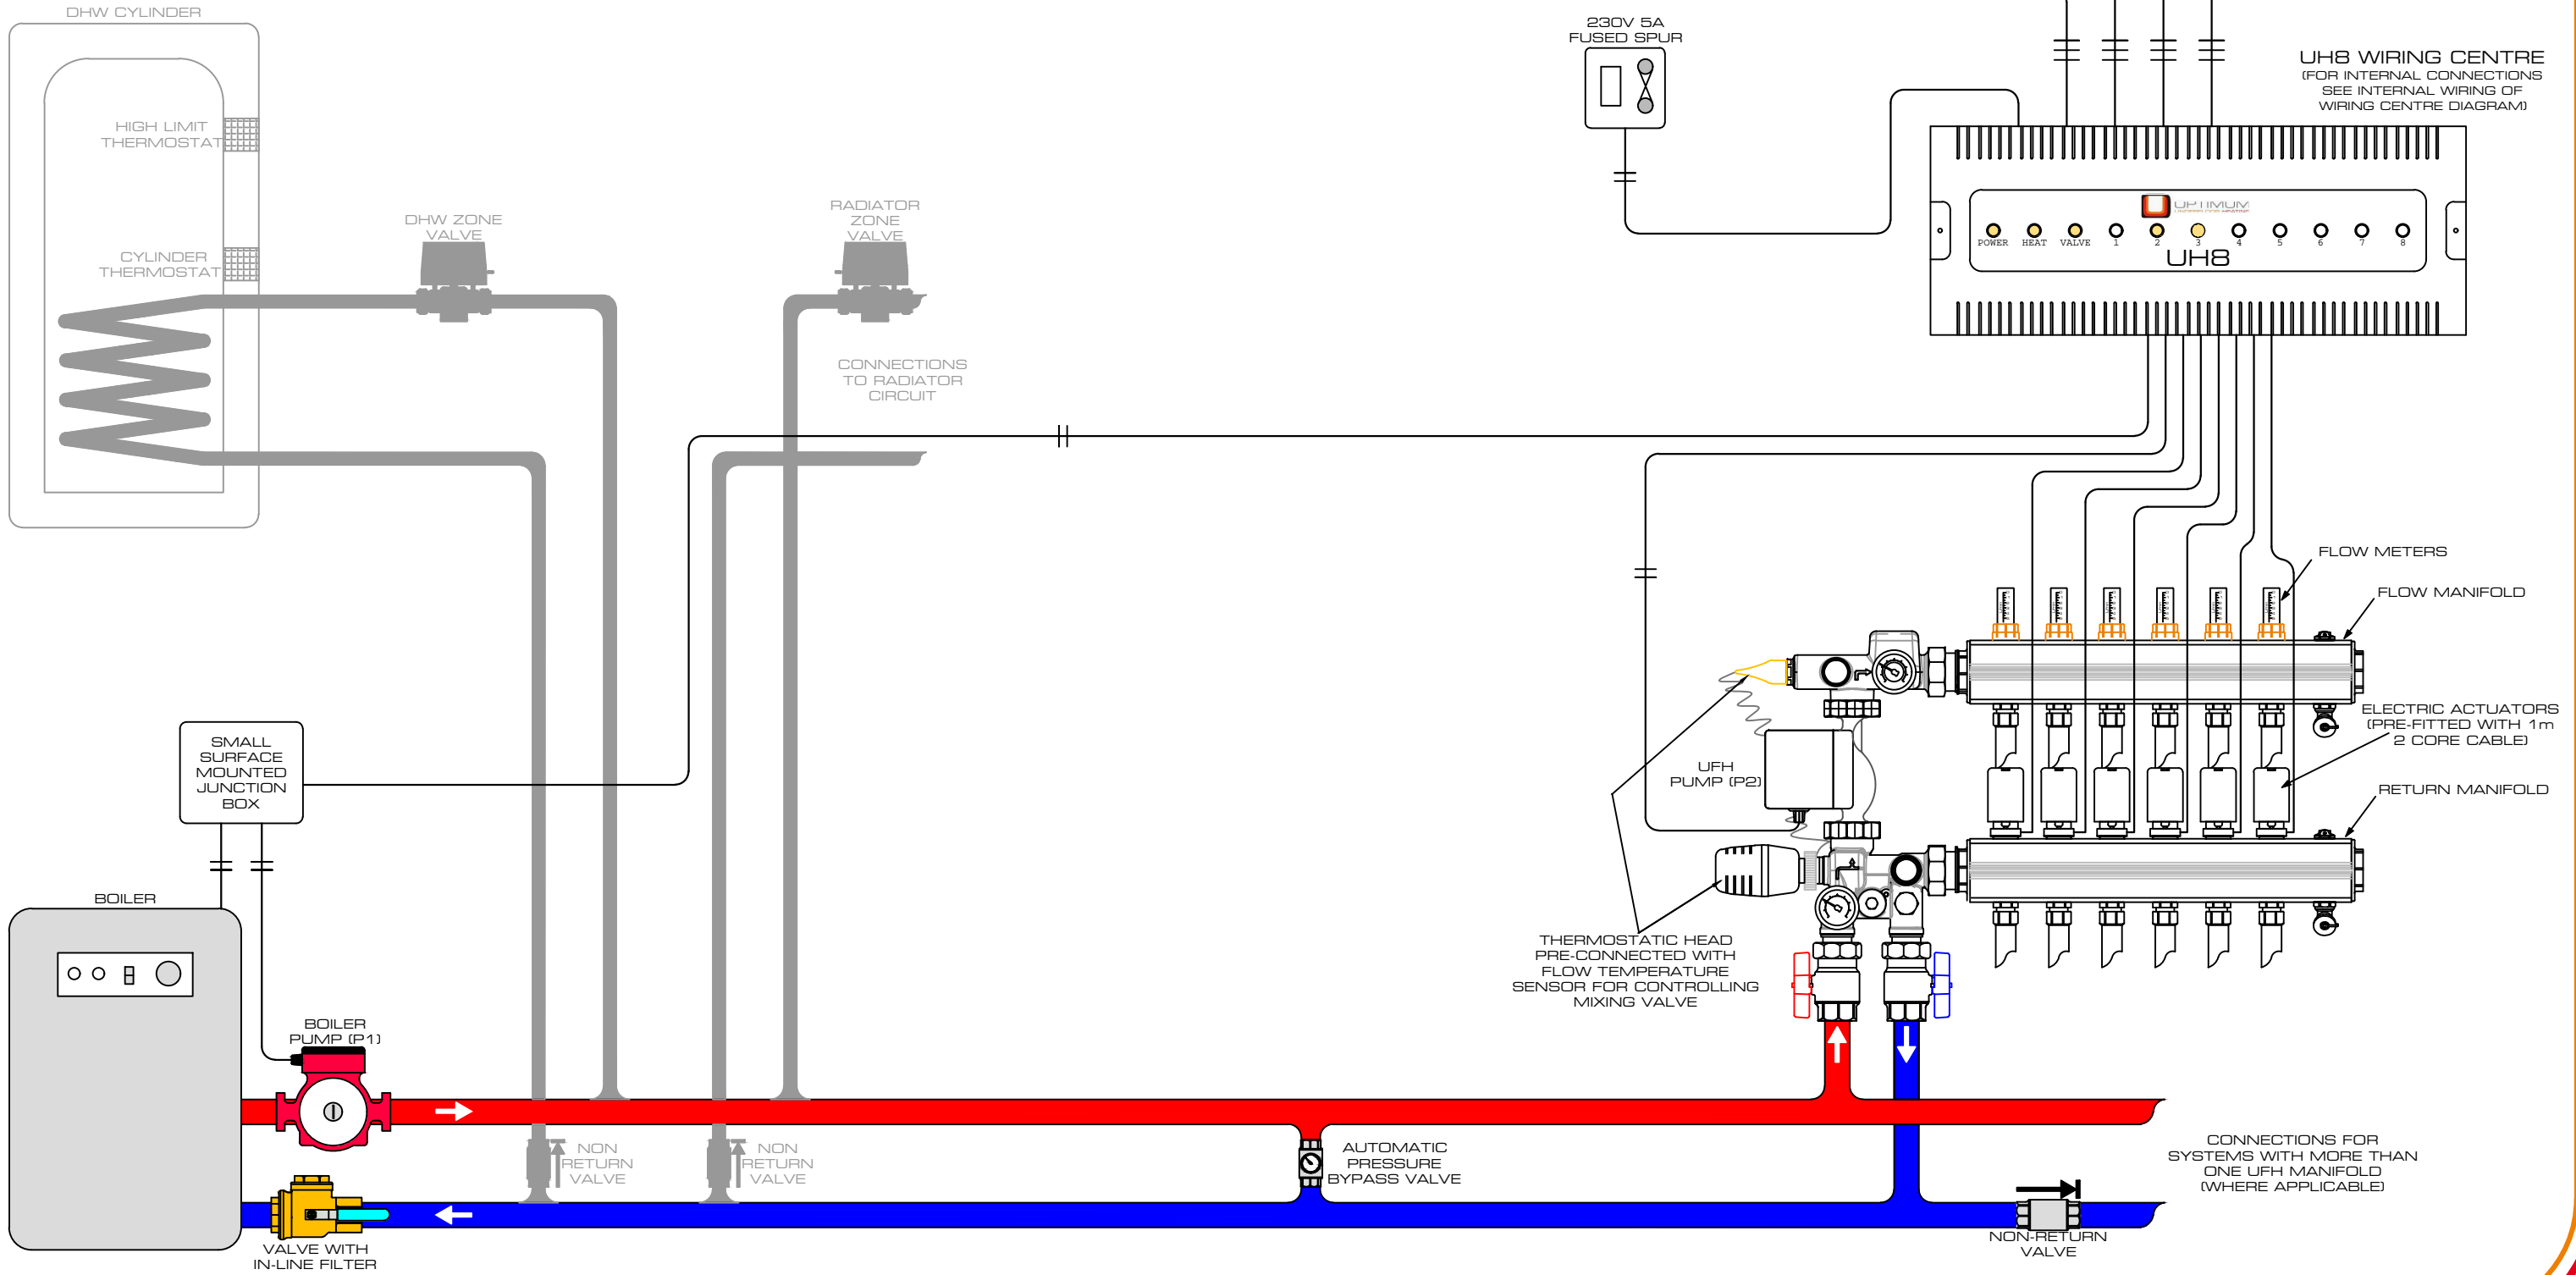

THERMOSTATIC HEAD PRE-CONNECTED WITH FLOW TEMPERATURE SENSOR FOR CONTROLLING MIXING VALVE

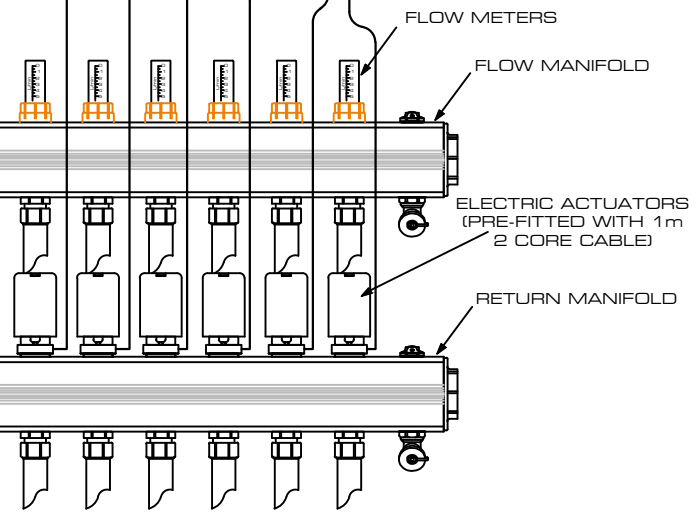

CONNECTIONS FOR SYSTEMS WITH MORE THAN ONE UH8 MANIFOLD (WHERE APPLICABLE)

